


Exova Warringtonfire
Holmesfield Road
Warrington
WA1 2DS
United Kingdom

T : +44 (0) 1925 655116
F : +44 (0) 1925 655419
E : warrington@exova.com
W: www.exova.com



ISO 5660-1:2015

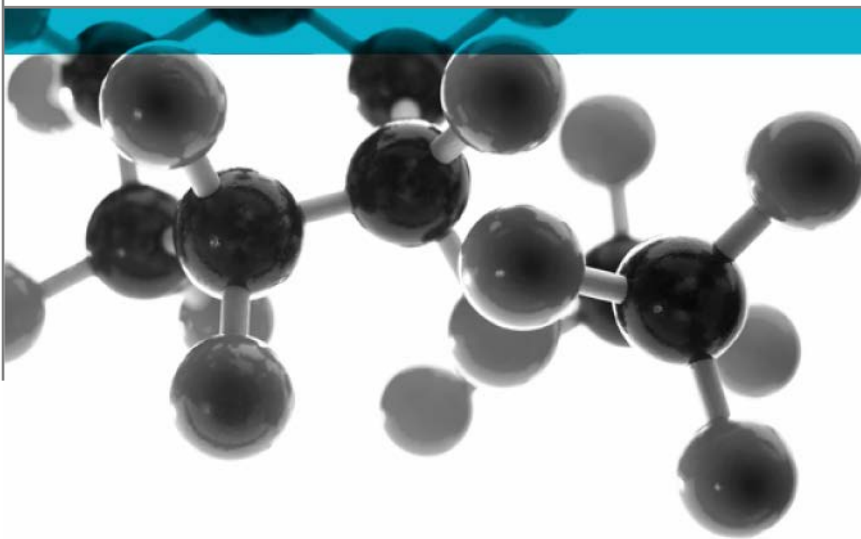

Heat release rate (Cone Calorimeter Method) & Smoke Production Rate (Dynamic Measurement)

A Report To: PPG Italia

Document Reference: 396287

Date: 8th May 2018

Issue No.: 2

Page 1

Testing
Advising
Assuring



Executive Summary

Objective To determine the performance of the following product when tested in accordance with ISO 5660-1:2015

Generic Description	Product reference	Thickness	Weight per unit area, density or specific gravity
Coated glass reinforced phenolic	"PPG R50059/698/2"	4mm	4.47kg/m ² *
Individual components used to manufacture composite:			
Coating	"Selemix Aqua 8-110/8-111"	2 x 30-40μ (Total 60-80μ)	1.9
Substrate	Unable to provide	4mm	1.3g/cm ³
*determined by Exova Warringtonfire			
Please see page 6 of this test report for the full description of the product tested			


Test Sponsor PPG Italia, Via Comasina 121, Milan, Italy

Test Results:	Peak Heat Release Rate	=	87.83kW/m²
	Total Heat Release	=	30.9MJ/m²
	MARHE	=	41.92kW/m²


Date of Test 6th March 2018

Reason for Revision This document replaces issue 1 (dated 9th March 2018) of the same number which has been withdrawn. The total film thickness was stated incorrectly in the issue 1 report. This has been amended in this issue 2 report.

Signatories



 Responsible Officer
 T. Mort *
 Senior Technical Officer



 Authorised
 S. Deeming *
 Business Unit Head

* For and on behalf of **Exova Warringtonfire**.

Report Issued: 8th May 2018

This version of the report has been produced from a .pdf format electronic file that has been provided by **Exova Warringtonfire** to the sponsor of the report and must only be reproduced in full. Extracts or abridgements of reports must not be published without permission of **Exova Warringtonfire**.

Document No.: 396287
 Author: C Jacques
 Client: PPG Italia

Page No.: 2 of 12
 Issue Date: 8th May 2018
 Issue No.: 2



0249

CONTENTS

PAGE NO.

EXECUTIVE SUMMARY2

SIGNATORIES.....2

TEST DETAILS.....4

DESCRIPTION OF TEST SPECIMENS.....6

TEST RESULTS7

TABLE 18

FIGURE 19

FIGURE 2.....9

FIGURE 3.....10

FIGURE 4.....10

FIGURE 5.....11

REVISION HISTORY12



Test Details

Purpose of test	<p>To determine the performance of a product when it is subjected to the conditions of the test specified in ISO 5660-1:2015, "Heat release rate (Cone Calorimeter Method)" and "Smoke Production Rate (Dynamic Measurement)".</p> <p>This test was performed in accordance with the procedures specified in ISO 5660-1 and this report should be read in conjunction with these standards.</p>
Scope of test	<p>ISO 5660-1:2015 specifies a method for assessing the heat release rate of a specimen exposed in the horizontal orientation to controlled levels of irradiance with an external igniter. The heat release rate is determined by measurement of the oxygen consumption derived from the oxygen concentration and the flow rate in the combustion product stream. The time to ignition (sustained flaming) is also measured in this test.</p> <p>The dynamic smoke production rate is calculated from measurement of the attenuation of a laser light beam by the combustion product stream. Smoke obscuration is recorded for the entire test, regardless of whether the specimen is flaming or not.</p>
Fire test study group/EGOLF	<p>Certain aspects of some fire test specifications are open to different interpretations. The Fire Test Study Group and EGOLF have identified a number of such areas and has agreed Resolutions which define common agreement of interpretations between fire test laboratories which are members of the Groups. Where such Resolutions are applicable to this test they have been followed.</p>
Test procedure	<p>The apparatus consists of a cone shaped, radiant electric heater, capable of producing a uniform irradiance of up to 100kW/m² on the surface of a 100mm x 100mm specimen, situated on a load cell. The heater is controlled by a temperature controller capable of holding the element temperature steady to within $\pm 2^{\circ}\text{C}$. External ignition is facilitated by a spark igniter powered from a 10kV transformer. Exhaust gases are drawn through a hood and duct by a centrifugal fan. An orifice plate positioned across the exhaust duct and connected to a pressure transducer, measures the volume flow. A ring sampler, situated in the duct, allows a representative sample of the exhaust gases to be drawn off and the oxygen concentration measured using an in-line, paramagnetic oxygen analyser.</p> <p>The heat release rate is calculated using the relationship that approximately 13.1 x 10³kJ of heat are released per kilogram of oxygen consumed. Visible smoke release is determined by means of a laser extinction beam photometer situated in the duct.</p>
Instruction to test	<p>The test was conducted on the 6th March 2018 at the request of PPG Italia, the sponsor of the test.</p>
Provision of test specimens	<p>The specimens were supplied by the sponsor of the test. Exova Warringtonfire was not involved in any selection or sampling procedure.</p>

Document No.:

396287

Page No.:

4 of 12

Author:

C Jacques

Issue Date:

8th May 2018

Client:

PPG Italia

Issue No.:

2



0249

Conditioning of specimens	<p>The specimens were received on the 16th February 2018.</p> <p>Prior to test the specimens were conditioned to constant mass at a temperature of $23 \pm 2^{\circ}\text{C}$ and a relative humidity of $50 \pm 5\%$.</p>
Test face	The coated face of each specimen was exposed to the igniting flame.
Test orientation	Horizontal.
Specimen preparation	A retaining frame was used, leaving an exposed specimen surface area of $8.836 \times 10^{-3}\text{m}^2$. A retaining wire grid was not used.
Number of replicate tests	Three specimens were subjected to an irradiance of $50\text{kW}/\text{m}^2$.
Frequency of measurement	The data was recorded every two seconds throughout the tests.
Orifice plate calibration factor	0.04057
Exhaust system flow rate	The exhaust flow rate was set to $0.024 \pm 0.002 \text{ m}^3/\text{s}$.
End of test criteria	The data was collected for a period of 1200 seconds.
Test operator	H. Harper

Description of Test Specimens

The description of the system given below has been prepared from information provided by the sponsor of the test. This information has not been independently verified by **Exova Warringtonfire**.

All values quoted are nominal, unless tolerances are given.

General description		Coated glass reinforced phenolic
Product reference		"PPG R50059/698/2"
Overall thickness		4mm (stated by sponsor) 3.58mm (determined by Exova Warringtonfire)
Overall weight per unit area		4.47kg/m ² (determined by Exova Warringtonfire)
Coating	Generic type	Waterborne 2-pack polyurethane coating
	Product reference	"Selemix Aqua 8-110 / 8-111"
	Name of manufacturer	PPG Industries
	Colour reference	"Ral 7035" "Grey" (observed by Exova Warringtonfire)
	Number of coats	2
	Application thickness per coat	30-40μ (Total 60-80μ)
	Specific gravity	1.9
	Application method	Conventional high volume low spray
	Curing process per coat	20 minutes air dry between coats at 20°C
Flame retardant details		See Note 1 Below
Glass reinforced phenolic	Generic type	Glass reinforced phenolic The sponsor was unable to provide specific details of the glass reinforcement and resin
	Product reference	See Note 2 Below
	Name of manufacturer	Pro Test Panels
	Thickness	4mm
	Density	1.3g/cm ³
Flame retardant details		See Note 1 Below
Brief description of manufacturing process		See Note 2 Below

Note 1: The sponsor of the test has confirmed that no flame retardants were used in the production of this component.

Note 2: The sponsor of the test was unable to provide this information.

Test Results

Results of test

The test results relate only to the behaviour of the test specimens of the product under the particular conditions of test, they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.

The test results relate only to the specimens of the product in the form in which they were tested. Small differences in the composition or thickness of the product may significantly affect the performance during the test and will therefore invalidate the test results. It is the responsibility of the supplier of the product to ensure that the product which is supplied is identical to the specimens which were tested.

The data generated during the tests are contained in Table 1.

Graphs of heat release rate, total heat release, smoke production rate, total smoke production and average heat release rate are shown in Figures 1 to 5 respectively.

Observations

None

Validity

The specification and interpretation of fire test methods are the subject of ongoing development and refinement. Changes in associated legislation may also occur. For these reasons it is recommended that the relevance of test reports over five years old should be considered by the user. The laboratory that issued the report will be able to offer, on behalf of the legal owner, a review of the procedures adopted for a particular test to ensure that they are consistent with current practices, and if required may endorse the test report.

This report may only be reproduced in full. Extracts or abridgements shall not be published without permission of **Exova Warringtonfire**.

Table 1

PARAMETER		Test 1	Test 2	Test 3	Mean
Time to sustained flaming	seconds	159	165	67	130
Test duration	seconds	1200	1200	1200	1200
Peak heat release rate	$\dot{\phi}''_{max}$ kWm ⁻²	78.03	98.18	87.29	87.83
Time to peak heat release rate	seconds	192	198	260	217
Total heat release	q''_{tot} MJm ⁻²	29.1	29.2	34.4	30.9
Average $\dot{\phi}''$ for 180 sec after ignition	$\dot{\phi}''_{180}$ kWm ⁻²	65.48	73.61	57.47	65.52
Average $\dot{\phi}''$ for 300 sec after ignition	$\dot{\phi}''_{300}$ kWm ⁻²	57.23	58.88	59.44	58.52
Initial specimen mass	$m_{initial}$ g	53.22	49.31	46.10	49.54
Final specimen mass	m_{final} g	30.60	27.34	25.99	27.98
Mass loss	g/m ²	2629.08	2570.26	2273.41	2490.92
Mass at sustained flaming	g	48.41	43.53	44.74	45.56
Smoke production non flaming phase (m ² /m ²)	S_1'' dimensionless	63.99	58.28	32.20	51.49
Smoke production flaming phase (m ² /m ²)	S_2'' dimensionless	411.45	404.50	561.92	459.29
Total smoke production	$S_1'' + S_2''$ dimensionless (m ² /m ²)	475.44	462.78	594.12	510.78
Peak smoke production rate	\dot{S}''_{max} s ⁻¹ ≡ [(m ² s ⁻¹)/m ²]	1.437	1.599	1.433	1.490
Time to peak smoke production rate	seconds	190	198	246	211

Supplementary calculations

Maximum average heat release (MARHE)	kW/m ²	37.65	39.23	48.88	41.92
Time to MARHE	seconds	432	376	340	383

Figure 1

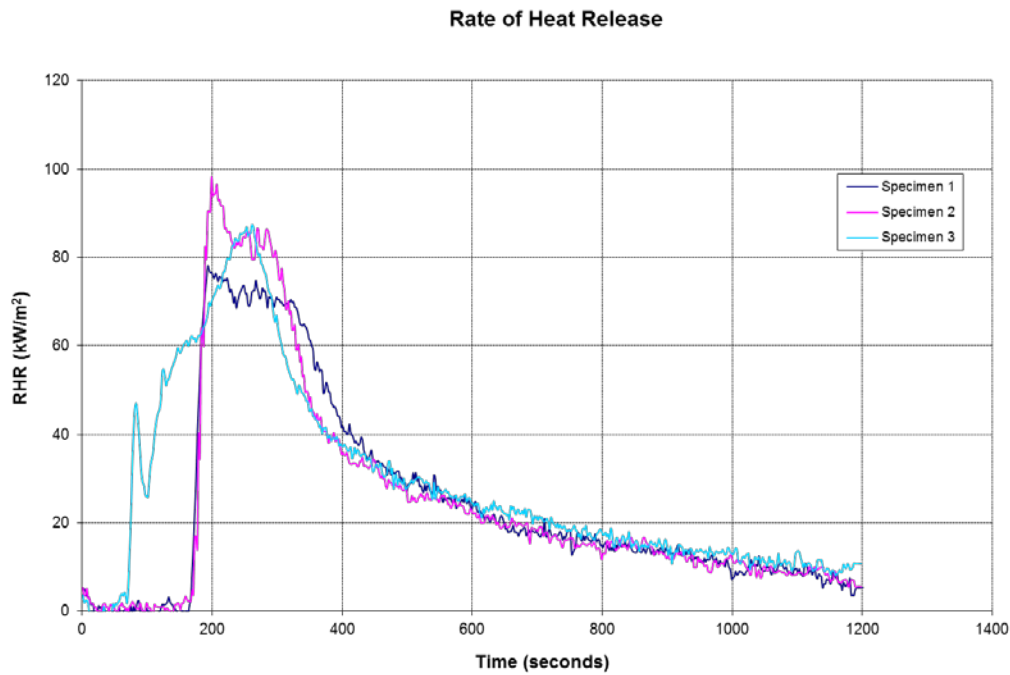


Figure 2

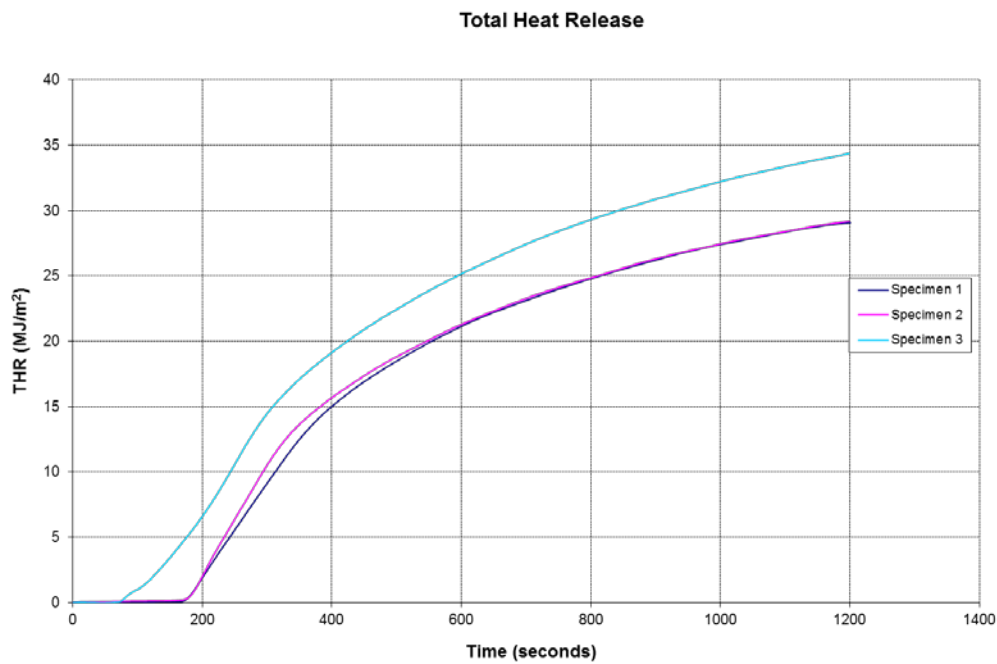


Figure 3

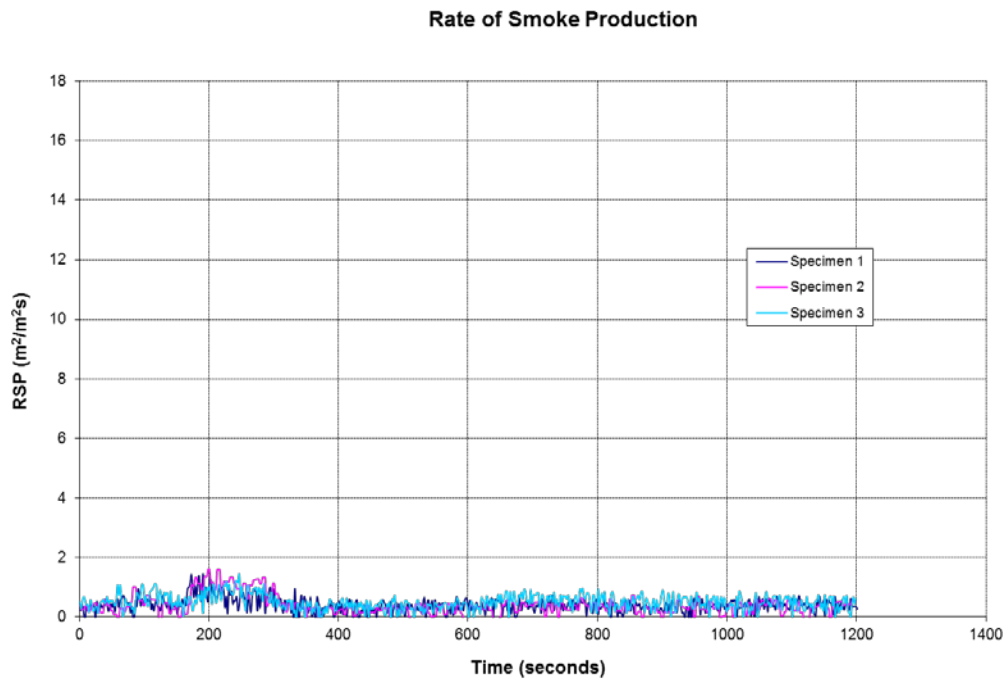


Figure 4


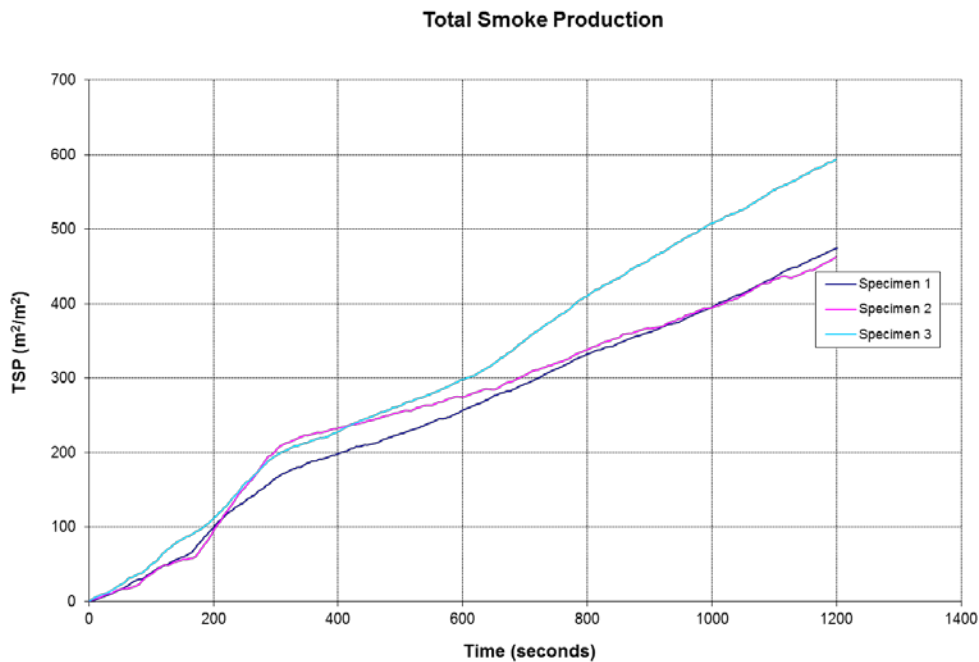


Figure 5

Average Rate of Heat Release

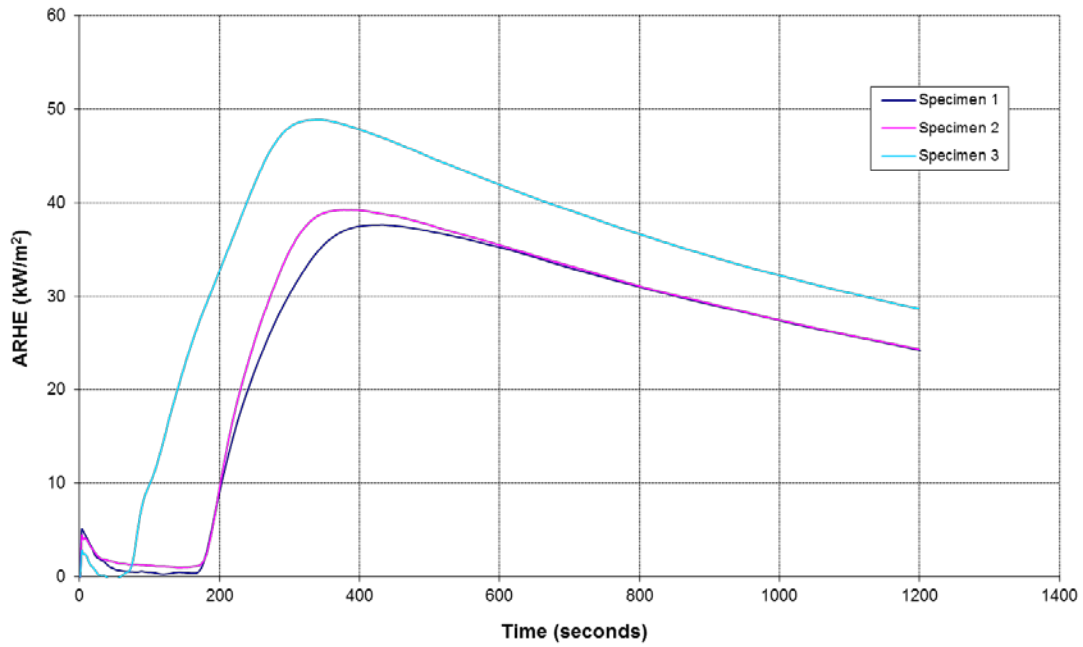

Revision History

Issue No : 2	Re-issue Date: 8th May 2018
Revised By: T. Mort	Approved By: S. Deeming
Reason for Revision: This document replaces issue 1 (dated 9 th March 2018) of the same number which has been withdrawn. The total film thickness was stated incorrectly in the issue 1 report. This has been amended in this issue 2 report.	

Issue No :	Re-issue Date:
Revised By:	Approved By:
Reason for Revision:	